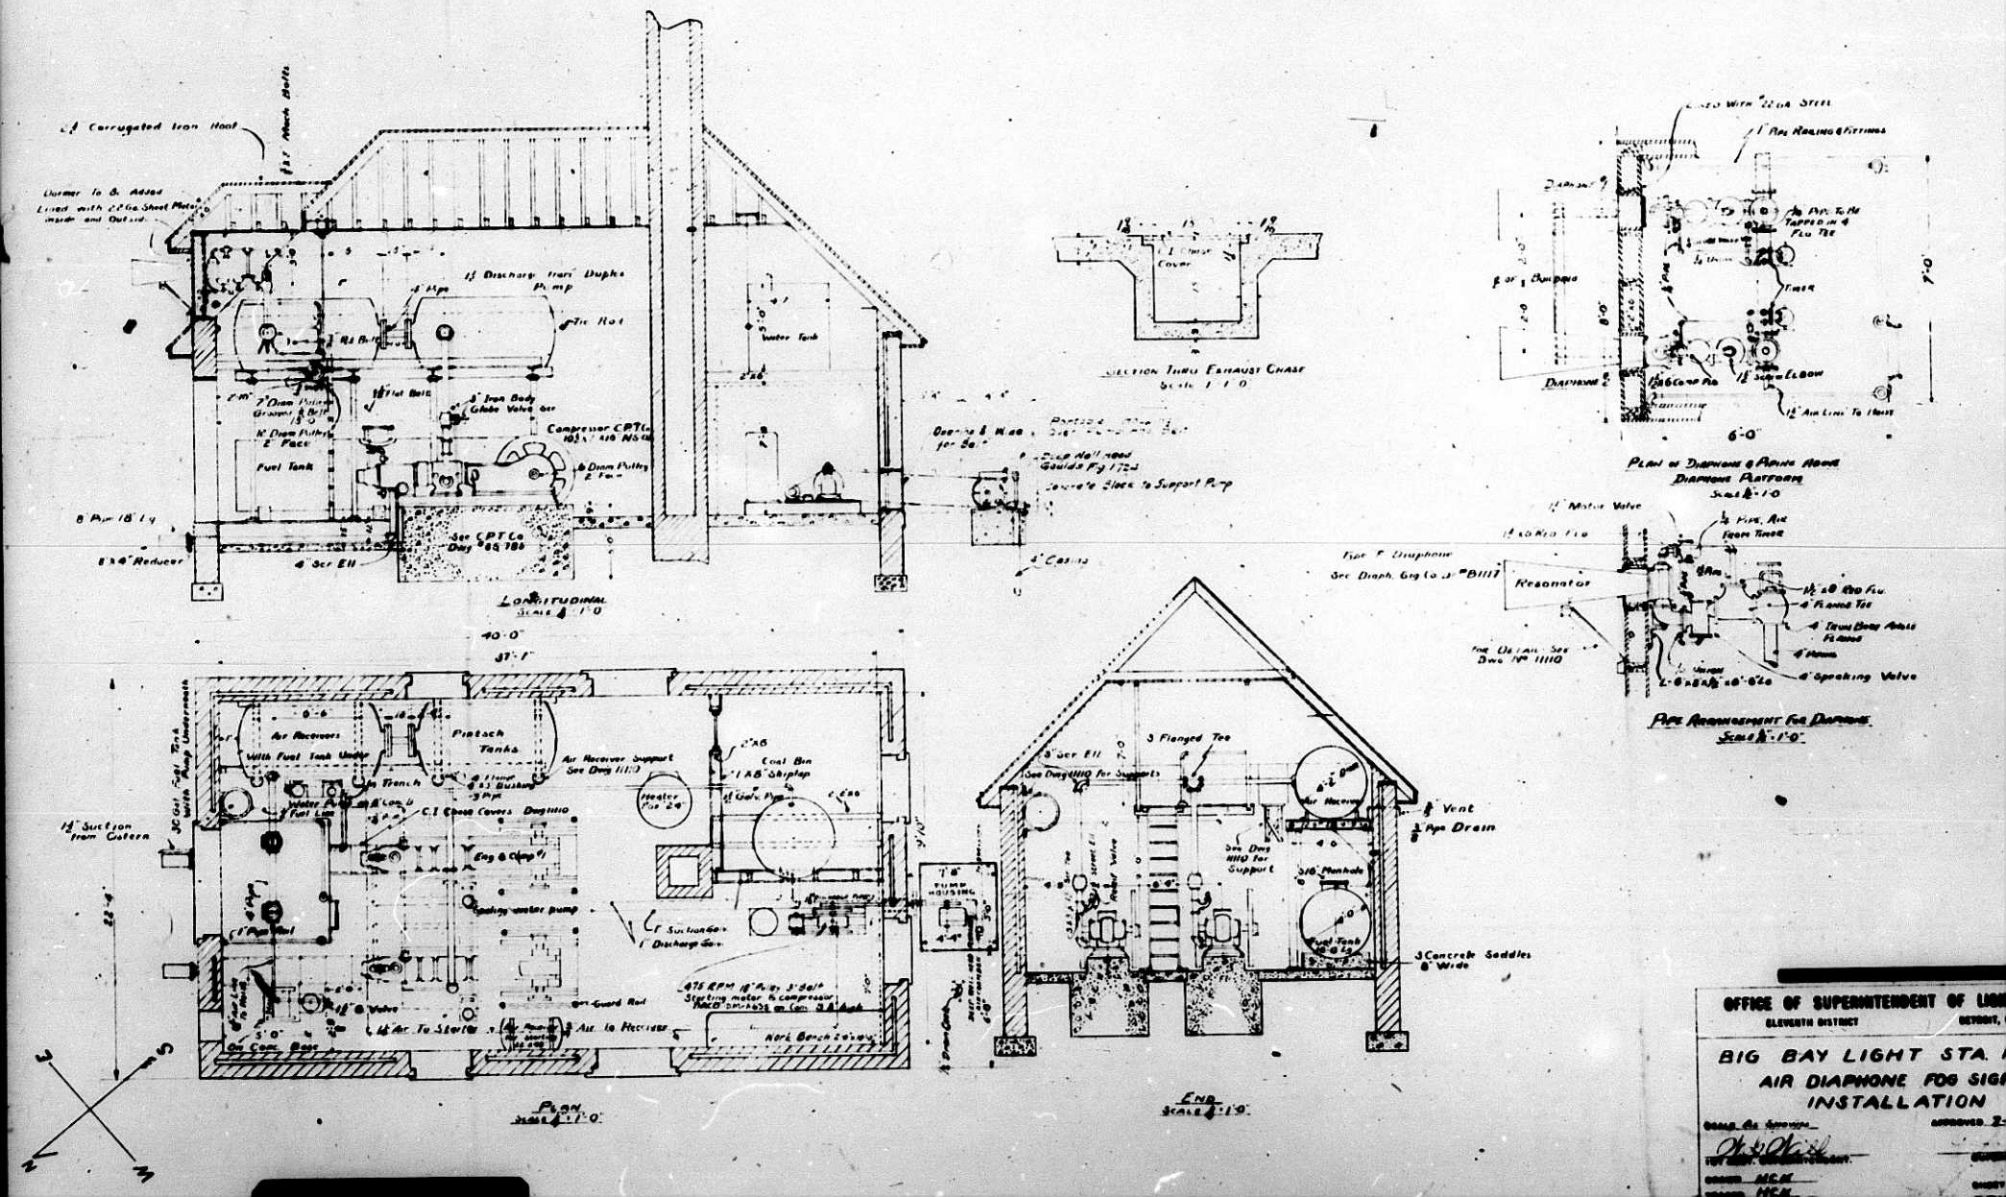

Corrugated Iron Roof
Discharge from Duplex Pump
Tie Rod
Fuel Tank
Compressor CPT Co
Water Tank
Section Thru Exhaust Chase
Scale 1" = 1'-0"
Concrete Block to Support Pump
Casing
Longitudinal
Scale 1/4" = 1'-0"
Plan of Diaphone & Piping Above Diaphone Platform
Scale 1/4" = 1'-0"
Resonator
Speaking Valve
Pipe Arrangement for Diaphone
Scale 1/4" = 1'-0"
Air Receivers
Pintsch Tanks
Air Receiver Support
Coal Bin
Heater
Suction from Cistern
Suction Gate
Discharge Gate
Guard Rail
Air to Receiver
Work Bench
Plan
Scale 1/4" = 1'-0"
Flanged Tee
Vent
Drain
Concrete Saddles
Wide
Fuel Tank
Pump Housing
End
Scale 1/4" = 1'-0"
OFFICE OF SUPERINTENDENT OF LIGH
ELEVENTH DISTRICT
DETROIT,
BIG BAY LIGHT STA.
AIR DIAPHONE FOG SIG
INSTALLATION